



521 Eagleton Downs Dr.
Suite F
Pineville, NC 28134
704-543-0903

Client: Arte NV
Industriezone De Waerde
Senator A. Jeurissenlaan 1210
BE-3520 Zonhoven

Test Report No: 75005

Date: 1-25-2011

The Following sample was submitted as: Flamant Suite V Mystic Impressions-Damask

DATE OF RECEIPT: 1-18-2011

TESTING PERIOD: 1-20-2011

TEST REQUESTED: The submitted sample was tested for flammability in
accordance with the procedures outlined in ASTM E-84-98.

SIGNED

A handwritten signature in black ink, appearing to be 'R. J. J. J.', is written over the 'SIGNED' text.



Arte NV
Industriezone De Waerde
Senator A. Jeurissenlaan
BE-3520 Zonhoven

521 Eagleton Downs Dr.
Suite F
Pineville, NC 28134
704-543-0903

#75005
Date: 1-25-2011

INTRODUCTION:

This report presents test results of Flame Spread and Smoke Developed Value per ASTM E-84-98. The report also includes Material Identification, Method of Preparation, Mounting and Conditioning of the specimens.

The test were performed in accordance with the specifications set forth in ASTM E-84-98, Standard Test Method for Surface Burning Characteristics of Building Materials, both as to equipment and test procedures. This test procedure is similar to UL-723, ANSI NO. 2.5, NFPA No. 255 and UBC 42-1.

The test results cover two parameters: Flame Spread and Smoke Developed Values during the 10-minute fire exposure. Inorganic cement board and red oak flooring are used as comparative standards and their responses are assigned arbitrary values of 0 and 100 respectively.

PREPARATION AND CONDITIONING:

Shur-stik III Vinyl Wallcovering Adhesive was applied to three (3) 2-feet x 8-feet sections of IC board. The sample was placed over the adhesive and allowed to cure.

The sample was conditioned at 73 +/- 5 Fahrenheit and 50 +/- relative humidity.

TEST PROCEDURE: Adhered

The tunnel was thoroughly pre-heated by burning natural gas. When the brick temperature, sensed by a floor thermocouple, had reached the prescribed 105 Fahrenheit +/- 5 Fahrenheit level, the sample was inserted in the tunnel at test conducted in accordance with the standard ASTM E-84-98 procedures.

The operation of the tunnel was checked by performing a 10-minute test with inorganic board the day of the test.



521 Eagleton Downs Dr.
Suite F
Pineville, NC 28134
704-543-0903

Arte NV
Indutriezone De Waerde
Senator A. Jeurissenlaan 1210
BE-3520 Zonhoven

#75005
Date: 1-25-2011

TEST RESULTS:

The test results, calculated in accordance with ASTM E-84-98 for Flame Spread and Smoke Developed Values are as follows:

Test Specimen: Flamant Suite V Mystic Impressions-Damask
Flame Index* 15
Smoke Developed Value* 150

Observation: The Tested Material meets the requirements for ASTM E-84


Rating: Class A

The National Fire Protection Association Life Safety Code 101, Section 6-5.3, "Interior Wall and Ceiling Finish Classification", has a means of classifying materials with respect to Flame Spread and Smoke Developed when tested in accordance with NFPA 255, "Method of Test of Surface Burning Characteristics of Building Materials", (ASTM E-84)


The classifications are as follows:

Class A Interior Wall & Ceiling Finish:	Flame Spread-	0-25
	Smoke Developed-	0-450
Class B Interior Wall & Ceiling Finish:	Flame Spread-	26-75
	Smoke Developed-	0-450
Class C Interior Wall & Ceiling Finish:	Flame Spread-	76-200
	Smoke Developed-	0-450

Client: Arte NV
Report No 75005
Sample: Flamant Suite V Mystic Impressions-Damask

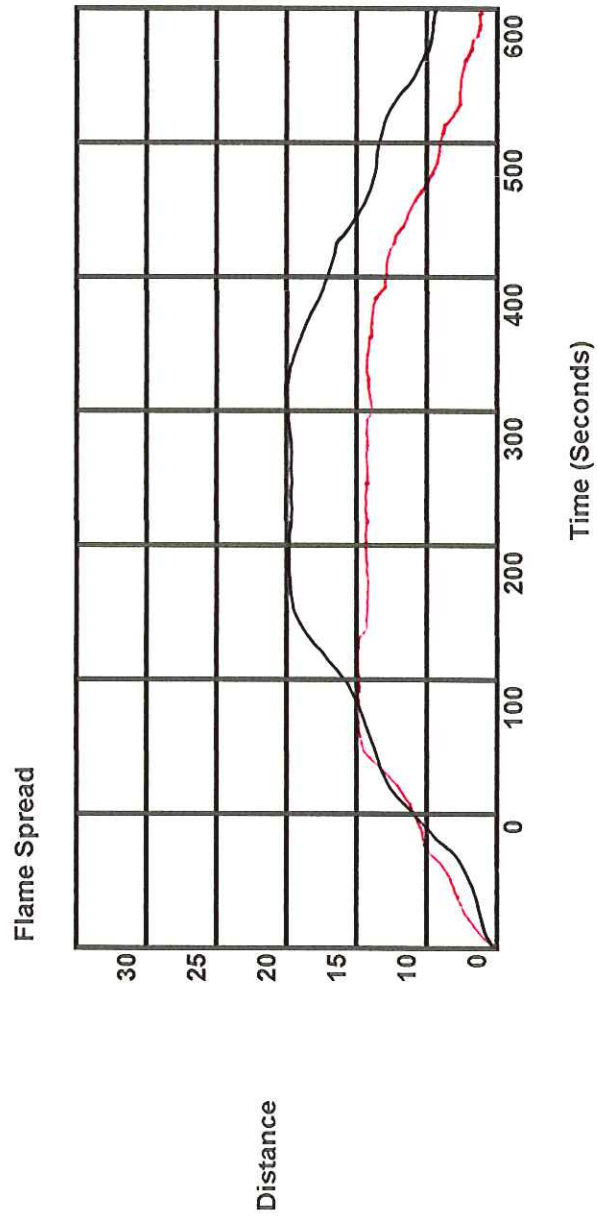

Client: Arte NV
Report No 75005
Sample: Flamant Suite V Mystic Impressions-Damask

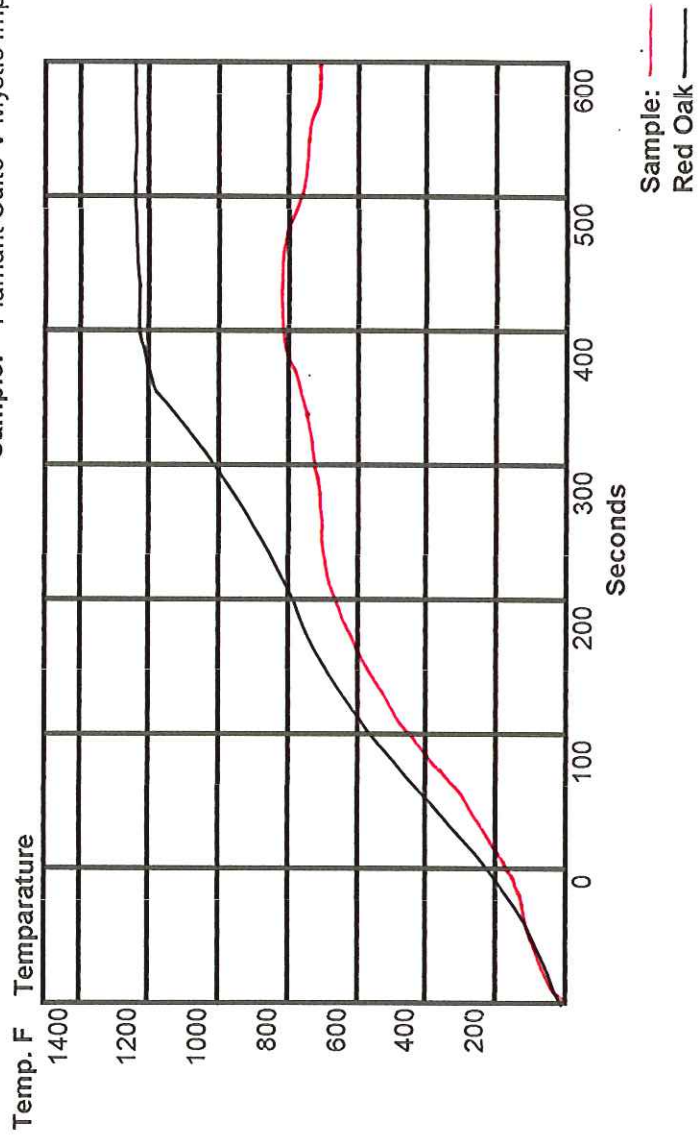

Client: Arte NV
Report #: 75005
Sample: Flamant Suite V Mystic Impressions-Damask

Smoke Developed:

