



520 Eagleton Downs Dr.
Suite D
Pineville, NC 28134
704-543-0903

Client: Arte NV
Industriezone De Waerde
Senator A. Jeurissenlaan 1210
BE-3520 Zonhoven

Test Report No: 116141

Date: 1-17-2014

The Following sample was submitted as: Flamant Les Mineraux 50012 Opale

DATE OF RECEIPT: 1-14-2014

TESTING PERIOD: 1-16-2014

TEST REQUESTED: The submitted sample was tested for flammability in accordance with the procedures outlined in ASTM E-84-98.

SIGNED

A handwritten signature in black ink, appearing to be 'William J. [unclear]', written over a horizontal line.



American Flamecoat Testing

Arte NV
Industriezone De Waerde
Senator A. Jeurissenlaan
BE-3520 Zonhoven

520 Eagleton Downs Dr.
Suite D
Pineville, NC 28134
704-543-0903

Date: 1-17-2014

INTRODUCTION:

This report presents test results of Flame Spread and Smoke Developed Value per ASTM E-84-98. The report also includes Material Identification, Method of Preparation, Mounting and Conditioning of the specimens.

The test were performed in accordance with the specifications set forth in ASTM E-84-98, Standard Test Method for Surface Burning Characteristics of Building Materials, both as to equipment and test procedures. This test procedure is similar to UL-723, ANSI NO. 2.5, NFPA No. 255 and UBC 42-1.

The test results cover two parameters: Flame Spread and Smoke Developed Values during the 10-minute fire exposure. Inorganic cement board and red oak flooring are used as comparative standards and their responses are assigned arbitrary values of 0 and 100 respectively.

PREPARATION AND CONDITIONING:


Shur-stik III Vinyl Wallcovering Adhesive was applied to three (3) 2-feet x 8-feet sections of IC board. The sample was placed over the adhesive and allowed to cure.

The sample was conditioned at 73 +/- 5 Fahrenheit and 50 +/- relative humidity.

TEST PROCEDURE:

The tunnel was thoroughly pre-heated by burning natural gas. When the brick temperature, sensed by a floor thermocouple, had reached the prescribed 105 Fahrenheit +/- 5 Fahrenheit level, the sample was inserted in the tunnel at test conducted in accordance with the standard ASTM E-84-98 procedures.

The operation of the tunnel was checked by performing a 10-minute test with inorganic board the day of the test.



American Flamecoat Testing

520 Eagleton Downs Dr.
Suite D
Pineville, NC 28134
704-543-0903

Arte NV
Indutriezone De Waerde
Senator A. Jeurissenlaan 1210
BE-3520 Zonhoven

Date: 1-17-2014

TEST RESULTS:

The test results, calculated in accordance with ASTM E-84-98 for Flame Spread and Smoke Developed Values are as follows:

Test Specimen: Flamant Les Mineraux 50012 Opale
Flame Index* 10
Smoke Developed Value* 115

Observation: The Tested Material **Meets the Requirements for ASTM E-84**


Rating: Class A

The National Fire Protection Association Life Safety Code 101, Section 6-5.3, "Interior Wall and Ceiling Finish Classification", has a means of classifying materials with respect to Flame Spread and Smoke Developed when tested in accordance with NFPA 255, "Method of Test of Surface Burning Characteristics of Building Materials", (ASTM E-84)


The classifications are as follows:

Class A Interior Wall & Ceiling Finish:	Flame Spread-	0-25
	Smoke Developed-	0-450
Class B Interior Wall & Ceiling Finish:	Flame Spread-	26-75
	Smoke Developed-	0-450
Class C Interior Wall & Ceiling Finish:	Flame Spread-	76-200
	Smoke Developed-	0-450

Client: Arte NV
Report #: 116141
Sample: Flamant Les Mineraux 50012 Opale

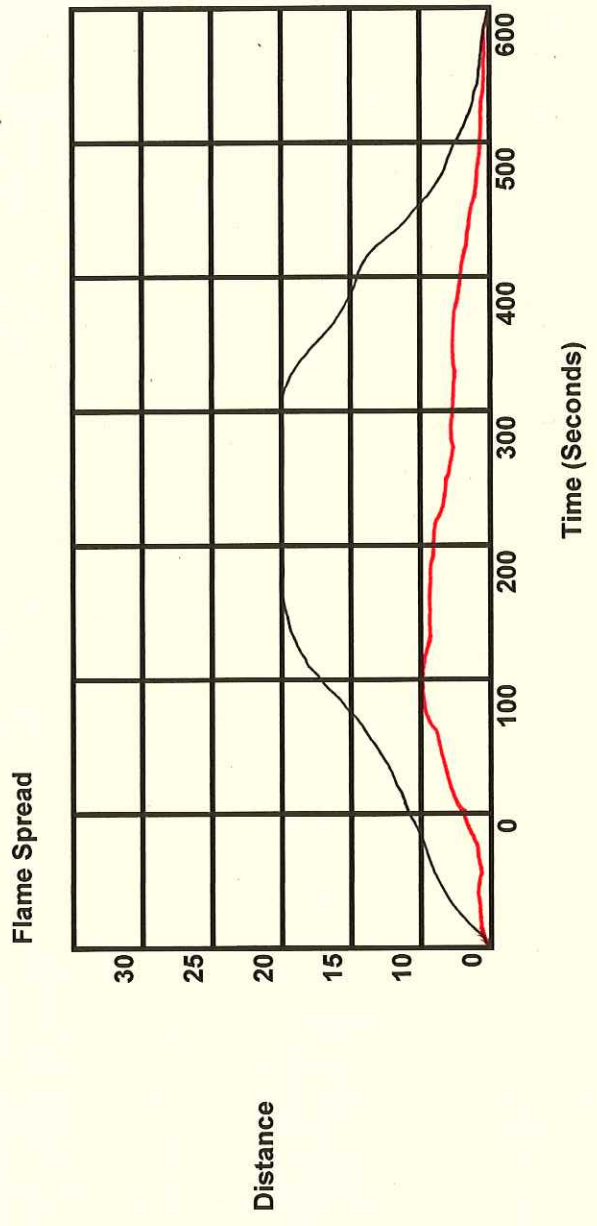



Client: Arte NV
Report #: 116141
Sample: Flamant Les Mineroux 50012 Opale

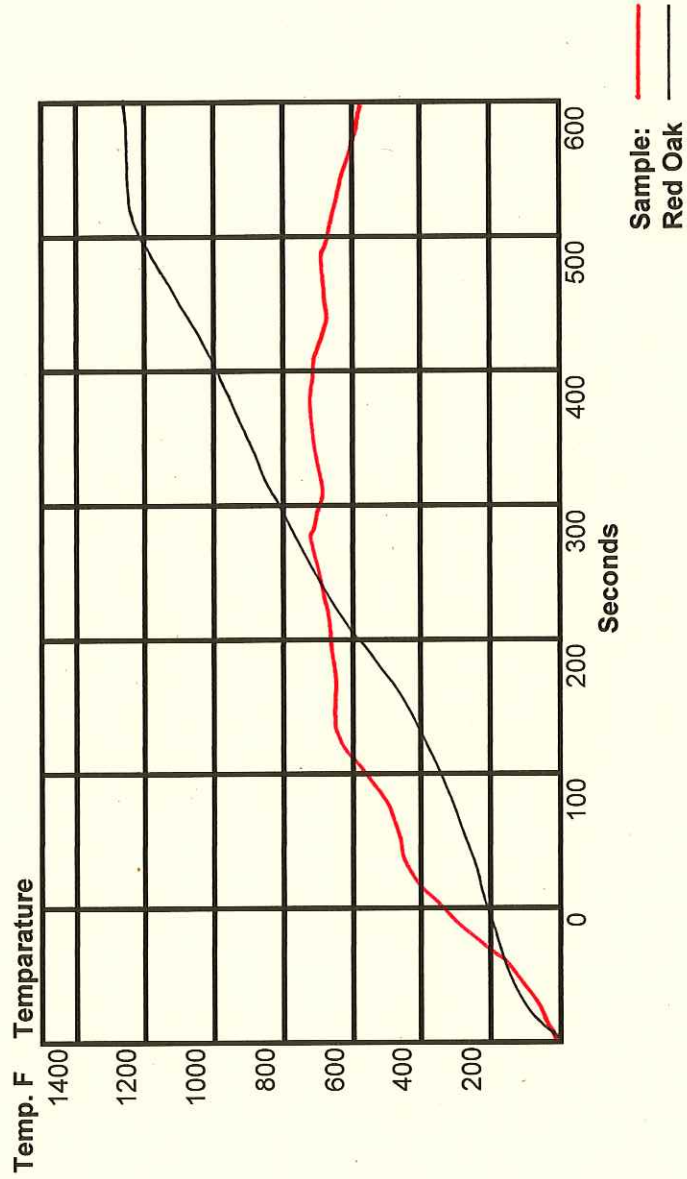

Client: Arte NV
Report #: 116141
Sample: Flamant Les Mineroux 50012 Opale

Smoke Developed:

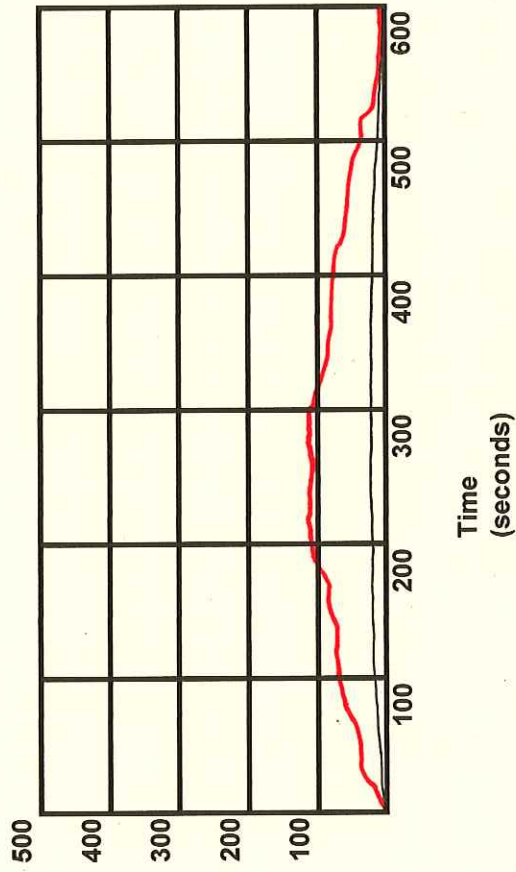



**American
Flamecoat
Testing**

520 Eagleton Downs Dr.
Suite D
Pineville, NC 28134
704-543-0903

Client: Arte NV
Industriezone De Waerde
Senator A. Jeurissenlaan 1210
BE-3520 Zonhoven

Test Report No: 116142

Date: 1-17-2014

The Following sample was submitted as: Flamant Les Mineraux 50053 Touquet

DATE OF RECEIPT: 1-14-2014

TESTING PERIOD: 1-16-2014

TEST REQUESTED: The submitted sample was tested for flammability in accordance with the procedures outlined in ASTM E-84-98.

SIGNED



Arte NV
Industriezone De Waerde
Senator A. Jeurissenlaan
BE-3520 Zonhoven

520 Eagleton Downs Dr.
Suite D
Pineville, NC 28134
704-543-0903

Date: 1-17-2014

INTRODUCTION:

This report presents test results of Flame Spread and Smoke Developed Value per ASTM E-84-98. The report also includes Material Identification, Method of Preparation, Mounting and Conditioning of the specimens.

The test were performed in accordance with the specifications set forth in ASTM E-84-98, Standard Test Method for Surface Burning Characteristics of Building Materials, both as to equipment and test procedures. This test procedure is similar to UL-723, ANSI NO. 2.5, NFPA No. 255 and UBC 42-1.

The test results cover two parameters: Flame Spread and Smoke Developed Values during the 10-minute fire exposure. Inorganic cement board and red oak flooring are used as comparative standards and their responses are assigned arbitrary values of 0 and 100 respectively.

PREPARATION AND CONDITIONING:

Shur-stik III Vinyl Wallcovering Adhesive was applied to three (3) 2-feet x 8-feet sections of IC board. The sample was placed over the adhesive and allowed to cure.

The sample was conditioned at 73 +/- 5 Fahrenheit and 50 +/- relative humidity.

TEST PROCEDURE:

The tunnel was thoroughly pre-heated by burning natural gas. When the brick temperature, sensed by a floor thermocouple, had reached the prescribed 105 Fahrenheit +/- 5 Fahrenheit level, the sample was inserted in the tunnel at test conducted in accordance with the standard ASTM E-84-98 procedures.

The operation of the tunnel was checked by performing a 10-minute test with inorganic board the day of the test.



520 Eagleton Downs Dr.
Suite D
Pineville, NC 28134
704-543-0903

Arte NV
Indutriezone De Waerde
Senator A. Jeurissenlaan 1210
BE-3520 Zonhoven

Date: 1-17-2014

TEST RESULTS:

The test results, calculated in accordance with ASTM E-84-98 for Flame Spread and Smoke Developed Values are as follows:

Test Specimen: Flamant Les Mineraux 50053 Touquet
Flame Index* 10
Smoke Developed Value* 110

Observation: The Tested Material **Meets the Requirements for ASTM E-84**

Rating: Class A


The National Fire Protection Association Life Safety Code 101, Section 6-5.3, "Interior Wall and Ceiling Finish Classification", has a means of classifying materials with respect to Flame Spread and Smoke Developed when tested in accordance with NFPA 255, "Method of Test of Surface Burning Characteristics of Building Materials", (ASTM E-84)

The classifications are as follows:


Class A Interior Wall & Ceiling Finish:	Flame Spread-	0-25
	Smoke Developed-	0-450
Class B Interior Wall & Ceiling Finish:	Flame Spread-	26-75
	Smoke Developed-	0-450
Class C Interior Wall & Ceiling Finish:	Flame Spread-	76-200
	Smoke Developed-	0-450

Client: Arte NV
Report #: 116142
Sample: Flamant Les Mineraux 50053 Touquet


Smoke Developed:

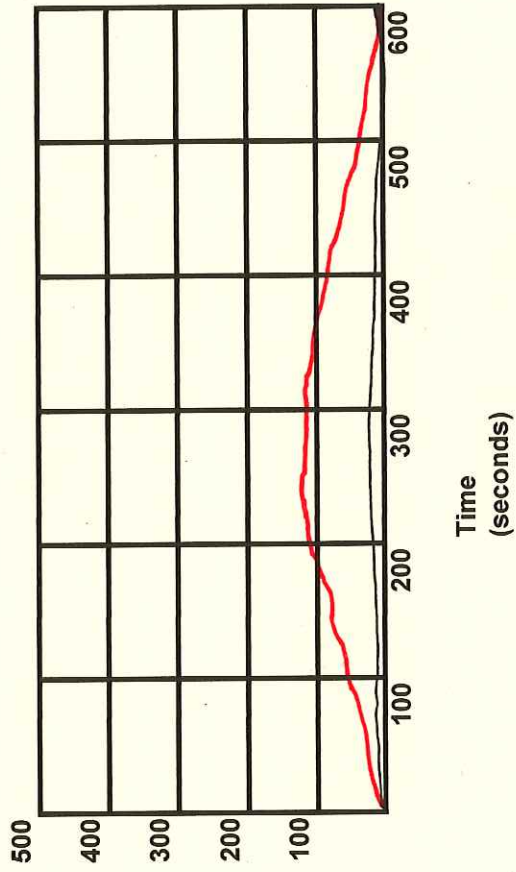


Client: Arte NV
Report #: 116142
Sample: Flamant Les Mineraux 50053 Touquet

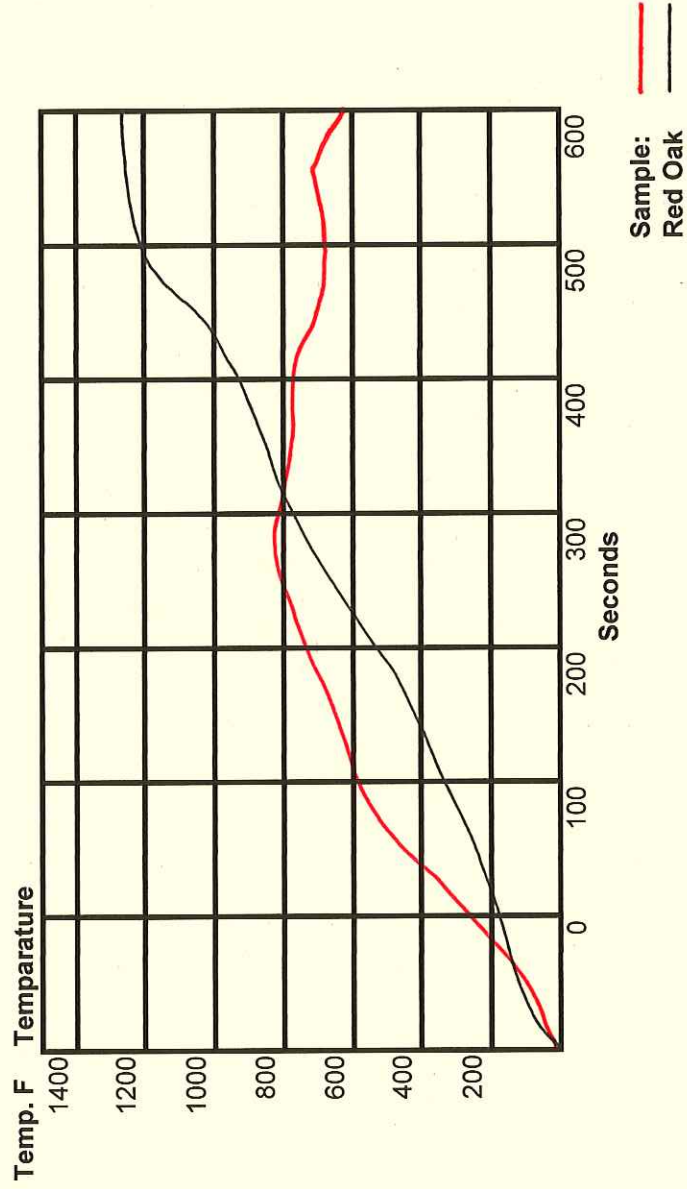

Client: Arte NV
Report #: 116142
Sample: Flamant Les Mineraux 50053 Touquet

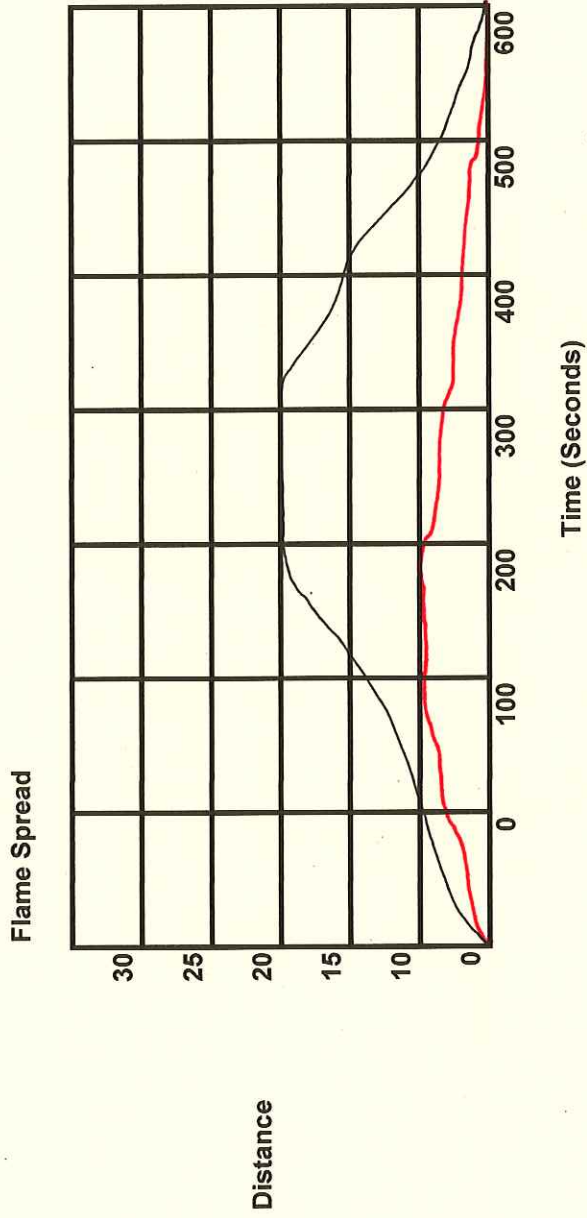



American Flamecoat Testing

520 Eagleton Downs Dr.
Suite D
Pineville, NC 28134
704-543-0903

Client: Arte NV
Industriezone De Waerde
Senator A. Jeurissenlaan 1210
BE-3520 Zonhoven

Test Report No: 116143

Date: 1-17-2014

The Following sample was submitted as: Flamant Les Mineraux 50102 Portel

DATE OF RECEIPT: 1-14-2014

TESTING PERIOD: 1-16-2014

TEST REQUESTED: The submitted sample was tested for flammability in accordance with the procedures outlined in ASTM E-84-98.

SIGNED



American Flamecoat Testing

Arte NV
Industriezone De Waerde
Senator A. Jeurissenlaan
BE-3520 Zonhoven

520 Eagleton Downs Dr.
Suite D
Pineville, NC 28134
704-543-0903

Date: 1-17-2014

INTRODUCTION:

This report presents test results of Flame Spread and Smoke Developed Value per ASTM E-84-98. The report also includes Material Identification, Method of Preparation, Mounting and Conditioning of the specimens.

The test were performed in accordance with the specifications set forth in ASTM E-84-98, Standard Test Method for Surface Burning Characteristics of Building Materials, both as to equipment and test procedures. This test procedure is similar to UL-723, ANSI NO. 2.5, NFPA No. 255 and UBC 42-1.

The test results cover two parameters: Flame Spread and Smoke Developed Values during the 10-minute fire exposure. Inorganic cement board and red oak flooring are used as comparative standards and their responses are assigned arbitrary values of 0 and 100 respectively.

PREPARATION AND CONDITIONING:


Shur-stik III Vinyl Wallcovering Adhesive was applied to three (3) 2-feet x 8-feet sections of IC board. The sample was placed over the adhesive and allowed to cure.

The sample was conditioned at 73 +/- 5 Fahrenheit and 50 +/- relative humidity.

TEST PROCEDURE:

The tunnel was thoroughly pre-heated by burning natural gas. When the brick temperature, sensed by a floor thermocouple, had reached the prescribed 105 Fahrenheit +/- 5 Fahrenheit level, the sample was inserted in the tunnel at test conducted in accordance with the standard ASTM E-84-98 procedures.

The operation of the tunnel was checked by performing a 10-minute test with inorganic board the day of the test.



American Flamecoat Testing

520 Eagleton Downs Dr.
Suite D
Pineville, NC 28134
704-543-0903

Arte NV
Indutriezone De Waerde
Senator A. Jeurissenlaan 1210
BE-3520 Zonhoven

Date: 1-17-2014

TEST RESULTS:

The test results, calculated in accordance with ASTM E-84-98 for Flame Spread and Smoke Developed Values are as follows:

Test Specimen: Flamant Les Mineraux 50102 Portel
Flame Index* 10
Smoke Developed Value* 90

Observation: The Tested Material **Meets the Requirements for ASTM E-84**

Rating: Class A


The National Fire Protection Association Life Safety Code 101, Section 6-5.3, "Interior Wall and Ceiling Finish Classification", has a means of classifying materials with respect to Flame Spread and Smoke Developed when tested in accordance with NFPA 255, "Method of Test of Surface Burning Characteristics of Building Materials", (ASTM E-84)

The classifications are as follows:


Class A Interior Wall & Ceiling Finish:	Flame Spread-	0-25
	Smoke Developed-	0-450
Class B Interior Wall & Ceiling Finish:	Flame Spread-	26-75
	Smoke Developed-	0-450
Class C Interior Wall & Ceiling Finish:	Flame Spread-	76-200
	Smoke Developed-	0-450

Client: Arte NV
Report #: 116143
Sample: Flamant Les Mineraux 50102 Portel


Smoke Developed:

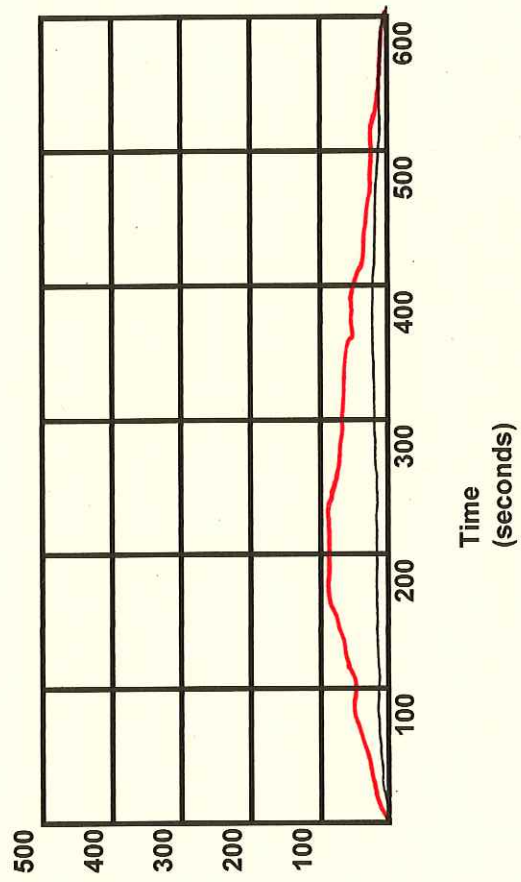

Client: Arte NV
Report #: 116143
Sample: Flamant Les Mineraux 50102 Portel

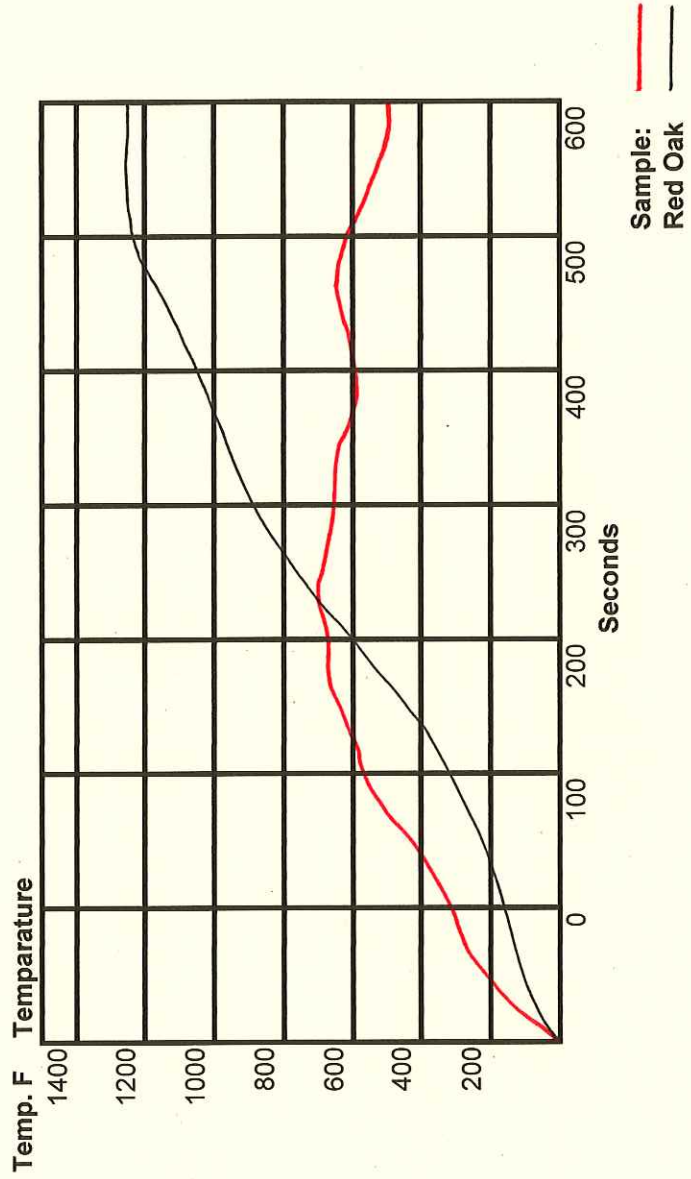

Client: Arte NV
Report #: 116143
Sample: Flamant Les Mineraux 50102 Portel

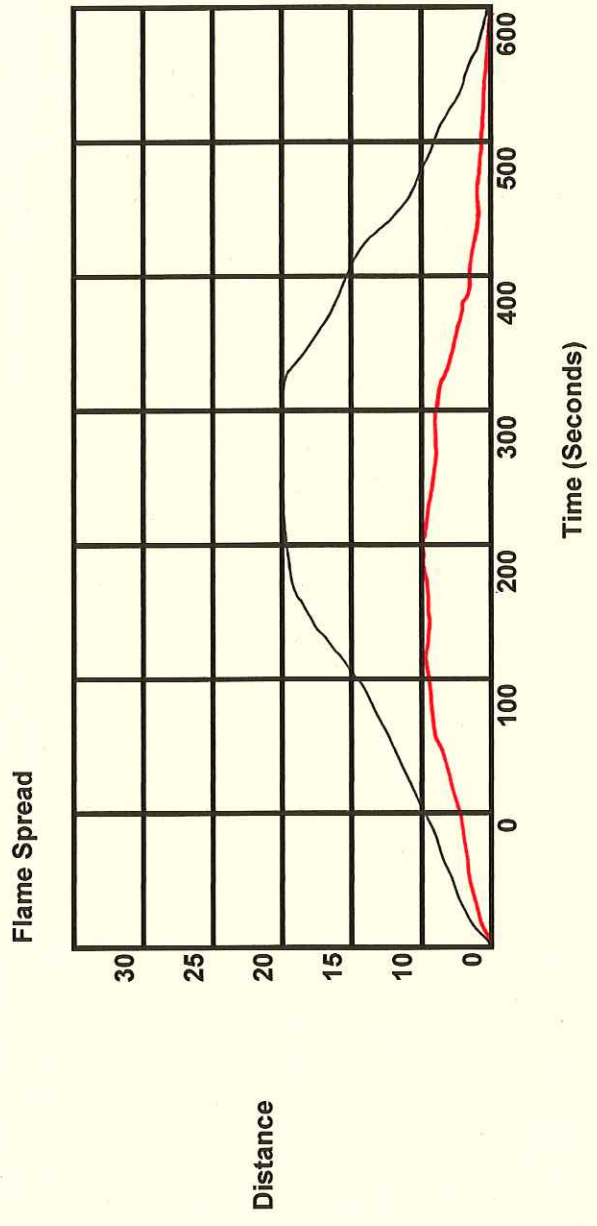



**American
Flamecoat
Testing**

520 Eagleton Downs Dr.
Suite D
Pineville, NC 28134
704-543-0903

Client: Arte NV
Industriezone De Waerde
Senator A. Jeurissenlaan 1210
BE-3520 Zonhoven

Test Report No: 116144

Date: 1-17-2014

The Following sample was submitted as: Flamant Les Mineraux 50150 Escalles

DATE OF RECEIPT: 1-14-2014

TESTING PERIOD: 1-16-2014

TEST REQUESTED: The submitted sample was tested for flammability in accordance with the procedures outlined in ASTM E-84-98.

SIGNED



American Flamecoat Testing

Arte NV
Industriezone De Waerde
Senator A. Jeurissenlaan
BE-3520 Zonhoven

520 Eagleton Downs Dr.
Suite D
Pineville, NC 28134
704-543-0903

Date: 1-17-2014

INTRODUCTION:

This report presents test results of Flame Spread and Smoke Developed Value per ASTM E-84-98. The report also includes Material Identification, Method of Preparation, Mounting and Conditioning of the specimens.

The test were performed in accordance with the specifications set forth in ASTM E-84-98, Standard Test Method for Surface Burning Characteristics of Building Materials, both as to equipment and test procedures. This test procedure is similar to UL-723, ANSI NO. 2.5, NFPA No. 255 and UBC 42-1.

The test results cover two parameters: Flame Spread and Smoke Developed Values during the 10-minute fire exposure. Inorganic cement board and red oak flooring are used as comparative standards and their responses are assigned arbitrary values of 0 and 100 respectively.

PREPARATION AND CONDITIONING:

Shur-stik III Vinyl Wallcovering Adhesive was applied to three (3) 2-foot x 8-foot sections of IC board. The sample was placed over the adhesive and allowed to cure.

The sample was conditioned at 73 +/- 5 Fahrenheit and 50 +/- relative humidity.

TEST PROCEDURE:

The tunnel was thoroughly pre-heated by burning natural gas. When the brick temperature, sensed by a floor thermocouple, had reached the prescribed 105 Fahrenheit +/- 5 Fahrenheit level, the sample was inserted in the tunnel at test conducted in accordance with the standard ASTM E-84-98 procedures.

The operation of the tunnel was checked by performing a 10-minute test with inorganic board the day of the test.



520 Eagleton Downs Dr.
Suite D
Pineville, NC 28134
704-543-0903

Arte NV
Indutriezone De Waerde
Senator A. Jeurissenlaan 1210
BE-3520 Zonhoven

Date: 1-17-2014

TEST RESULTS:

The test results, calculated in accordance with ASTM E-84-98 for Flame Spread and Smoke Developed Values are as follows:

Test Specimen: Flamant Les Mineraux 50150 Escalles
Flame Index* 15
Smoke Developed Value* 110

Observation: The Tested Material **Meets the Requirements for ASTM E-84**

Rating: Class A


The National Fire Protection Association Life Safety Code 101, Section 6-5.3, "Interior Wall and Ceiling Finish Classification", has a means of classifying materials with respect to Flame Spread and Smoke Developed when tested in accordance with NFPA 255, "Method of Test of Surface Burning Characteristics of Building Materials", (ASTM E-84)

The classifications are as follows:


Class A Interior Wall & Ceiling Finish:	Flame Spread-	0-25
	Smoke Developed-	0-450
Class B Interior Wall & Ceiling Finish:	Flame Spread-	26-75
	Smoke Developed-	0-450
Class C Interior Wall & Ceiling Finish:	Flame Spread-	76-200
	Smoke Developed-	0-450

Client: Arte NV
Report #: 116144
Sample: Flamant Les Mineraux 50150 Escalles

Smoke Developed:

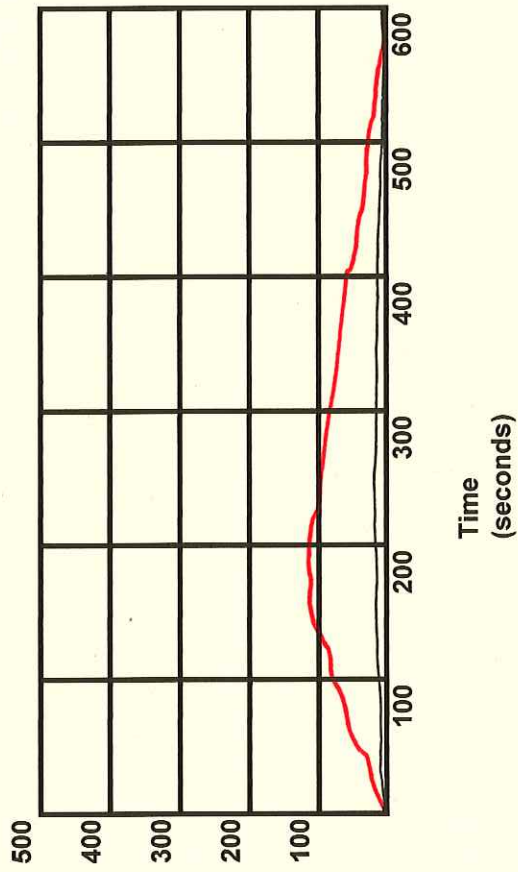

Client: Arte NV
Report #: 116144
Sample: Flamant Les Mineraux 50150 Escalles

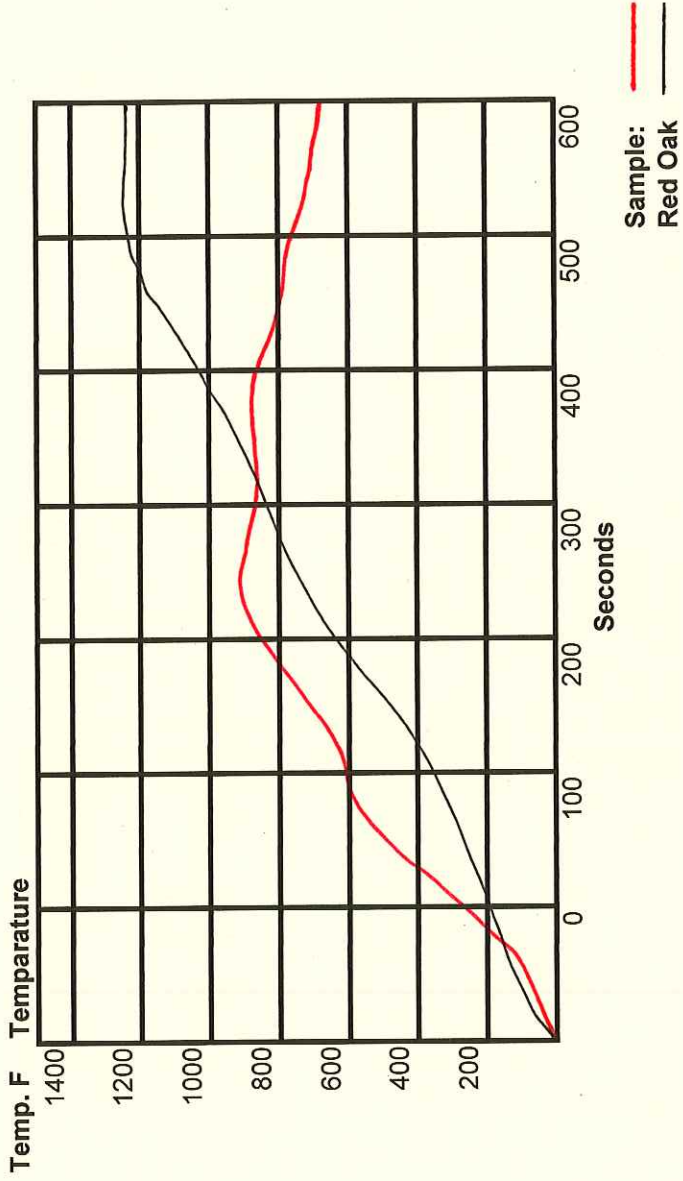

Client: Arte NV
Report #: 116144
Sample: Flamant Les Mineraux 50150 Escalles

