



**American
Flamecoat
Inc.**

520 Eagleton Downs Drive, Suite D
Pineville, NC 28134
704-405-2550
projects@americanflamecoat.net
www.americanflamecoat.net

Client: Arte NV
Industriezone De Waerde
Senator A. Jeurissenlaan 1210
BE-3520 Zonhoven

Test Report No: 210152

Date: 2-11-2015

The Following sample was submitted by the client as: Mousse 5mm (500 g/m² to 607 g/m²)

DATE OF RECEIPT: 1-09-2014

TESTING PERIOD: 1-14-2014

TEST REQUESTED: The submitted sample was tested for flammability in accordance with the procedures outlined in ASTM E-84-98.

SIGNED



American Flamecoat Inc.

520 Eagleton Downs Drive, Suite D
Pineville, NC 28134
704-405-2550
projects@americanflamecoat.net
www.americanflamecoat.net

INTRODUCTION:

This report presents test results of Flame Spread and Smoke Developed Value per ASTM E-84-98. The report also includes Material Identification, Method of Preparation, Mounting and Conditioning of the specimens.

The test were performed in accordance with the specifications set forth in ASTM E-84-98, Standard Test Method for Surface Burning Characteristics of Building Materials, both as to equipment and test procedures. This test procedure is similar to UL-723, ANSI NO. 2.5, NFPA No. 255 and UBC 42-1.

The test results cover two parameters: Flame Spread and Smoke Developed Values during the 10-minute fire exposure. Inorganic cement board and red oak flooring are used as comparative standards and their responses are assigned arbitrary values of 0 and 100 respectively.

PREPARATION AND CONDITIONING:

Shur-stik III Vinyl Wallcovering Adhesive was applied to three (3) 2-feet x 8-feet sections of IC board. The sample was placed over the adhesive and allowed to cure.

The sample was conditioned at 73 +/- 5 Fahrenheit and 50 +/- relative humidity.

TEST PROCEDURE:

The tunnel was thoroughly pre-heated by burning natural gas. When the brick temperature, sensed by a floor thermocouple, had reached the prescribed 105 Fahrenheit +/- 5 Fahrenheit level, the sample was inserted in the tunnel at test conducted in accordance with the standard ASTM E-84-98 procedures.

The operation of the tunnel was checked by performing a 10-minute test with inorganic board the day of the test.



American Flamecoat Inc.

520 Eagleton Downs Drive, Suite D
Pineville, NC 28134
704-405-2550
projects@americanflamecoat.net
www.americanflamecoat.net

TEST RESULTS:

The test results, calculated in accordance with ASTM E-84-98 for Flame Spread and Smoke Developed Values are as follows:

Test Specimen: Mousse 5mm (500 g/m² to 607 g/m²)
Flame Index* 15
Smoke Developed Value* 190

Observation: The Tested Material *Meets* the Requirements for A.S.T.M.E-84

Rating: Class A


The National Fire Protection Association Life Safety Code 101, Section 6-5.3, "Interior Wall and Ceiling Finish Classification", has a means of classifying materials with respect to Flame Spread and Smoke Developed when tested in accordance with NFPA 255, "Method of Test of Surface Burning Characteristics of Building Materials", (ASTM E-84)

The classifications are as follows:


Class A Interior Wall & Ceiling Finish:	Flame Spread-	0-25
	Smoke Developed-	0-450
Class B Interior Wall & Ceiling Finish:	Flame Spread-	26-75
	Smoke Developed-	0-450
Class C Interior Wall & Ceiling Finish:	Flame Spread-	76-200
	Smoke Developed-	0-450

Client: Arte NV
Report #: 210152
Sample: Mousse 5mm (500 g/m² to 607 g/m²)

Smoke Developed:

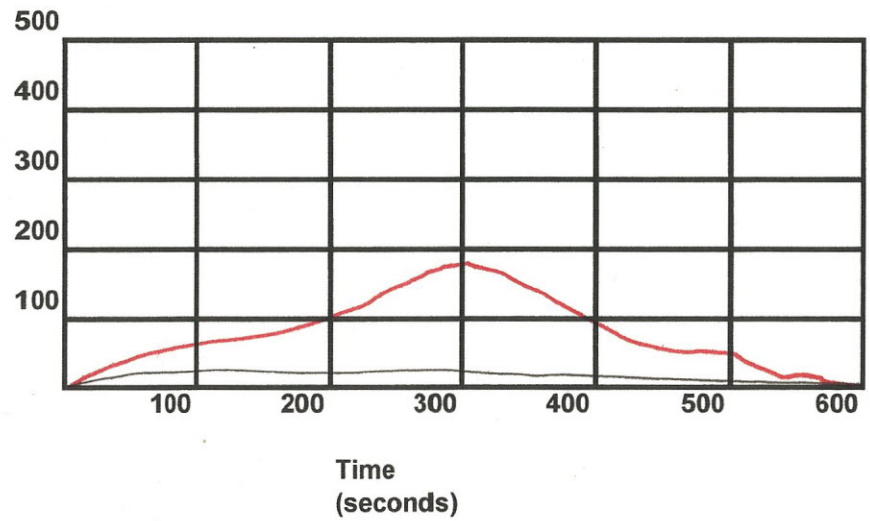

Client: Arte NV
Report #: 210152
Sample: Mousse 5mm (500 g/m² to 607 g/m²)

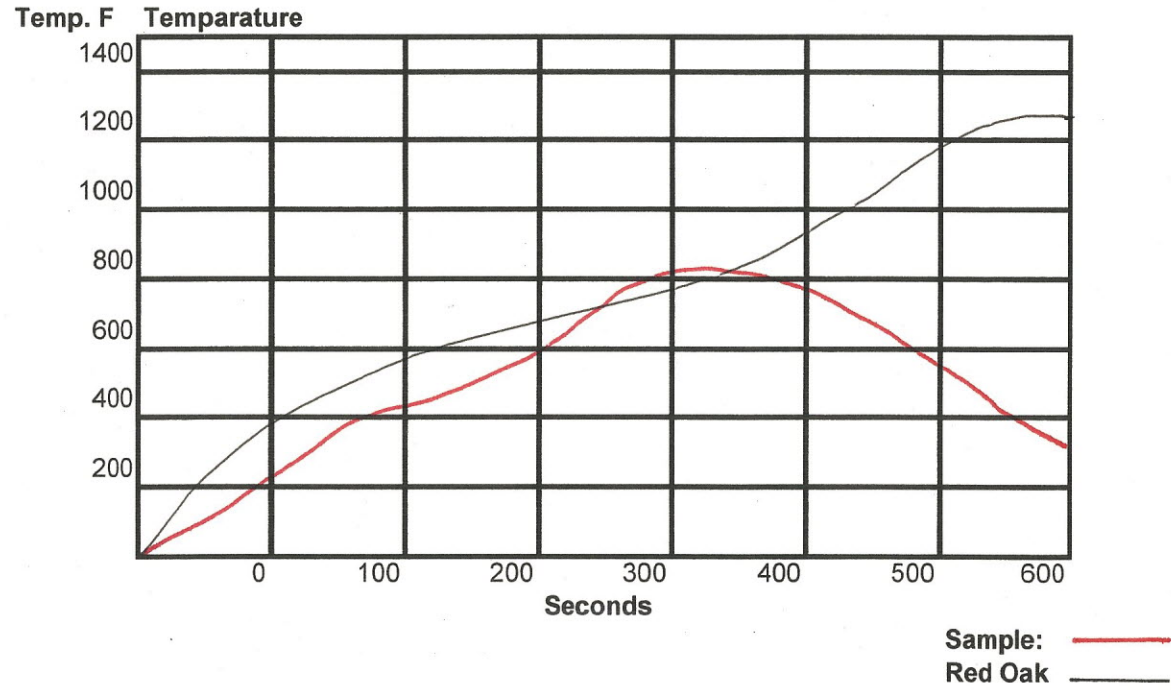

Client: Arte NV
Report #: 210152
Sample: Mousse 5mm (500 g/m² to 607 g/m²)

